

**NOTICE OF TEST RESULTS**

Facility: Watkins Mill Park Camp

Test Date: January 14, 2026

Date Results Received: February 23, 2026

Summary of Results:

- Type of Result: Final
- Number of Outlets Tested: 32
- Number of Outlets with results at or above 5ppb: 2
  - See enclosed email from vendor

Implemented Remediation Efforts:

- Install filtration system from Walter Louis Fluid Technologies and post non potable water sign above fixture.

OA-FMDC Next Steps:

- All fixtures above 5PPB will be retested once remediation is complete

Requirements of Statute:

- DYS must make all test results and any lead remediation plans available on the school's website within two weeks of receiving said test result. R.S.Mo. § 160.077.4(3)
- If a test result exceeds 5ppb, DYS shall contact parents and staff via written notification within seven business days of the above date. This notice must include:
  - The above written test results and explanation;
  - A description of the previously implemented and planned remediation efforts; and
  - A description of general health effects of lead contamination and community specific resources. *Id.* at (7).
- OA-FMDC shall provide bottled water if the disuse of outlets during the remediation and retesting period results in not enough water to meet the drinking water needs of the students, teachers, and staff. *Id.*
- DYS shall submit annual testing results to DHSS. *Id.*

# SAMPLES	NAME OF FACILITY	ADDRESS	FEDERAL LEVEL DETECTED (Standard = < 0.015 mg/L) (ND = Not Detected)	STATE OF MO LEVEL DETECTED (Standard = < 5 ppb) (ND = Not Detected)
<b>64</b>	<b>Watkins Mill Park Camp - Lawson, MO</b>	25610 Park Road N Lawson, MO 64062	SO# 54332	
1	SAMPLE LOCATION	1 <b>FD</b> Dorm C Mechanical Room Water Main	0.015 mg/L	15 ppb
2	SAMPLE LOCATION	1 <b>FL</b> Dorm C Mechanical Room Water Main	ND	ND
3	SAMPLE LOCATION	2 <b>FD</b> Dorm C Restroom Faucet	ND	ND
4	SAMPLE LOCATION	2 <b>FL</b> Dorm C Restroom Faucet	ND	ND
5	SAMPLE LOCATION	3 <b>FD</b> Dorm C Restroom Faucet	ND	ND
6	SAMPLE LOCATION	3 <b>FL</b> Dorm C Restroom Faucet	ND	ND
7	SAMPLE LOCATION	4 <b>FD</b> Dorm C Restroom Faucet	ND	ND
8	SAMPLE LOCATION	4 <b>FL</b> Dorm C Restroom Faucet	ND	ND
9	SAMPLE LOCATION	5 <b>FD</b> Dorm B Restroom Faucet	ND	ND
10	SAMPLE LOCATION	5 <b>FL</b> Dorm B Restroom Faucet	ND	ND
11	SAMPLE LOCATION	6 <b>FD</b> Dorm B Restroom Faucet	ND	ND
12	SAMPLE LOCATION	6 <b>FL</b> Dorm B Restroom Faucet	ND	ND
13	SAMPLE LOCATION	7 <b>FD</b> Dorm B Restroom Faucet	ND	ND
14	SAMPLE LOCATION	7 <b>FL</b> Dorm B Restroom Faucet	ND	ND
15	SAMPLE LOCATION	8 <b>FD</b> Staff Restroom Faucet	ND	ND
16	SAMPLE LOCATION	8 <b>FL</b> Staff Restroom Faucet	ND	ND
17	SAMPLE LOCATION	9 <b>FD</b> Staff Restroom Faucet	ND	ND
18	SAMPLE LOCATION	9 <b>FL</b> Staff Restroom Faucet	ND	ND
19	SAMPLE LOCATION	10 <b>FD</b> Dining Water Fountain	ND	ND
20	SAMPLE LOCATION	10 <b>FL</b> Dining Water Fountain	ND	ND
21	SAMPLE LOCATION	11 <b>FD</b> Kitchen Sprayer Faucet	ND	ND
22	SAMPLE LOCATION	11 <b>FL</b> Kitchen Sprayer Faucet	ND	ND

**FD = First Draw      FL = Flush**

# SAMPLES	NAME OF FACILITY	ADDRESS	FEDERAL LEVEL DETECTED (Standard = < 0.015 mg/L) (ND = Not Detected)	STATE OF MO LEVEL DETECTED (Standard = < 5 ppb) (ND = Not Detected)
<b>64</b>	<b>Watkins Mill Park Camp - Lawson, MO</b>	25610 Park Road N Lawson, MO 64062	SO# 54332	
23	SAMPLE LOCATION	12 <b>FD</b> Kitchen Dishwasher	ND	ND
24	SAMPLE LOCATION	12 <b>FL</b> Kitchen Dishwasher	0.002 mg/L	2 ppb
25	SAMPLE LOCATION	13 <b>FD</b> Kitchen Hand Sink Faucet	ND	ND
26	SAMPLE LOCATION	13 <b>FL</b> Kitchen Hand Sink Faucet	ND	ND
27	SAMPLE LOCATION	14 <b>FD</b> Kitchen Dish Sink Faucet	0.002 mg/L	2 ppb
28	SAMPLE LOCATION	14 <b>FL</b> Kitchen Dish Sink Faucet	ND	ND
29	SAMPLE LOCATION	15 <b>FD</b> Kitchen Dish Sink Faucet	ND	ND
30	SAMPLE LOCATION	15 <b>FL</b> Kitchen Dish Sink Faucet	ND	ND
31	SAMPLE LOCATION	16 <b>FD</b> Kitchen Dish Sink Faucet	ND	ND
32	SAMPLE LOCATION	16 <b>FL</b> Kitchen Dish Sink Faucet	ND	ND
33	SAMPLE LOCATION	17 <b>FD</b> Kitchen Ice Machine	0.003 mg/L	3 ppb
34	SAMPLE LOCATION	17 <b>FL</b> Kitchen Ice Machine	ND	ND
35	SAMPLE LOCATION	18 <b>FD</b> Guest Restroom Faucet	ND	ND
36	SAMPLE LOCATION	18 <b>FL</b> Guest Restroom Faucet	ND	ND
37	SAMPLE LOCATION	19 <b>FD</b> Water Fountain	ND	ND
38	SAMPLE LOCATION	19 <b>FL</b> Water Fountain	ND	ND
39	SAMPLE LOCATION	20 <b>FD</b> Guest Restroom Faucet	ND	ND
40	SAMPLE LOCATION	20 <b>FL</b> Guest Restroom Faucet	ND	ND
41	SAMPLE LOCATION	21 <b>FD</b> Dorm D Restroom Faucet	ND	ND
42	SAMPLE LOCATION	21 <b>FL</b> Dorm D Restroom Faucet	ND	ND
43	SAMPLE LOCATION	22 <b>FD</b> Dorm D Restroom Faucet	ND	ND
44	SAMPLE LOCATION	22 <b>FL</b> Dorm D Restroom Faucet	ND	ND
45	SAMPLE LOCATION	23 <b>FD</b> Dorm D Restroom Faucet	ND	ND
46	SAMPLE LOCATION	23 <b>FL</b> Dorm D Restroom Faucet	ND	ND

**FD = First Draw**      **FL = Flush**

# SAMPLES	NAME OF FACILITY	ADDRESS	FEDERAL LEVEL DETECTED (Standard = < 0.015 mg/L) (ND = Not Detected)	STATE OF MO LEVEL DETECTED (Standard = < 5 ppb) (ND = Not Detected)
<b>64</b>	<b>Watkins Mill Park Camp - Lawson, MO</b>	25610 Park Road N Lawson, MO 64062	SO# 54332	
45	SAMPLE LOCATION	23 <b>FD</b> Dorm D Restroom Faucet	ND	ND
46	SAMPLE LOCATION	23 <b>FL</b> Dorm D Restroom Faucet	ND	ND
47	SAMPLE LOCATION	24 <b>FD</b> Dorm E Restroom Faucet	ND	ND
48	SAMPLE LOCATION	24 <b>FL</b> Dorm E Restroom Faucet	ND	ND
49	SAMPLE LOCATION	25 <b>FD</b> Dorm E Restroom Faucet	ND	ND
50	SAMPLE LOCATION	25 <b>FL</b> Dorm E Restroom Faucet	ND	ND
51	SAMPLE LOCATION	26 <b>FD</b> Dorm E Restroom Faucet	ND	ND
52	SAMPLE LOCATION	26 <b>FL</b> Dorm E Restroom Faucet	ND	ND
53	SAMPLE LOCATION	27 <b>FD</b> Dorm A Kitchenette Faucet	ND	ND
54	SAMPLE LOCATION	27 <b>FL</b> Dorm A Kitchenette Faucet	ND	ND
55	SAMPLE LOCATION	28 <b>FD</b> Dorm A Staff Restroom Faucet	ND	ND
56	SAMPLE LOCATION	28 <b>FL</b> Dorm A Staff Restroom Faucet	ND	ND
57	SAMPLE LOCATION	29 <b>FD</b> Dorm A Restroom Faucet	ND	ND
58	SAMPLE LOCATION	29 <b>FL</b> Dorm A Restroom Faucet	ND	ND
59	SAMPLE LOCATION	30 <b>FD</b> Dorm A Restroom Faucet	ND	ND
60	SAMPLE LOCATION	30 <b>FL</b> Dorm A Restroom Faucet	ND	ND
61	SAMPLE LOCATION	31 <b>FD</b> Dorm A Restroom Faucet	ND	ND
62	SAMPLE LOCATION	31 <b>FL</b> Dorm A Restroom Faucet	ND	ND
63	SAMPLE LOCATION	32 <b>FD</b> Dorm A Mechanical Room Water Main	0.660 mg/L	660 ppb
64	SAMPLE LOCATION	32 <b>FL</b> Dorm A Mechanical Room Water Main	0.180 mg/L	180 ppb

\*\*ADVANCED NOTICE WRONG - SAID 0.066 mg/L 66 ppb)

\*\*ADVANCED NOTICE WRONG - SAID 0.018 mg/L 18 ppb)

**FD = First Draw**      **FL = Flush**

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490727

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #1FD 4190208(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	0.015*	1	1/14/2026 07:47		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166

(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490728

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #1FL 4190247(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

## Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:49		1/28/2026

Analyst	Tests
JD	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490729

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #2FD 4190227(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:40		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490730

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #2FL 4190204(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:42		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490731

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #3FD 4190220(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:42		1/28/2026

Analyst	Tests
JD	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490732

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808

Source: #3FL 4190194(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:44		1/28/2026

Analyst	Tests
JD	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490733

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #4FD 4190222(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:43		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

ANALYTICAL REPORTS

SAMPLE CODE: 490734  
 2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #4FL 4190202(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

- "ND" This contaminant was not detected at or above our lower reporting limit (LRL)
- "NA" Not Analyzed
- "Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.
- "LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.
- "DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:45		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490735

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #5FD 4190229(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:28		1/28/2026

Analyst	Tests
JD	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490736

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #5FL 4190200(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:30		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166

(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490737

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #6FD 4190230(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:31		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490738

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #6FL 4190198(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:33		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490739

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #7FD 4190221(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:33		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490740

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #7FL 4190195(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:35		1/28/2026

Analyst	Tests
JD	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

ANALYTICAL REPORTS

SAMPLE CODE: 490741

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #8FD 4190215(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:41		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166

(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490742

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #8FL 4190245(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

## Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:43		1/31/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490743

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #9FD 4190240(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:38		1/31/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490744

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #9FL 4190190(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:40		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490745

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #10FD 4190235(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:34		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490746

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #10FL 4190189(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:36		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490747

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808

Source: #11FD 4190224(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:13		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490748

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #11FL 4190181(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:15		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

ANALYTICAL REPORTS

SAMPLE CODE: 490749

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #12FD 4190241(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
<b>Inorganic Analytes - Metals</b>										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:16	1/27/2026	1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490750

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #12FL 4190186(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	0.002	1	1/14/2026 07:18	1/27/2026	1/31/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490751

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #13FD 4190217(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:19		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490752

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #13FL 4190187(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:21		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490753

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #14FD 4190238(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	0.002	1	1/14/2026 07:22		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490754

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #14FL 4190175(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:24		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490755

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #15FD 4190210(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:24		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490756

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #15FL 4190248(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:26		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490757

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #16FD 4190212(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:28		1/31/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490758

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #16FL 4190183(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:30		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490759

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #17FD 4190218(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	0.003	1	1/14/2026 07:30	1/27/2026	1/31/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490760

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #17FL 4190196(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:32	1/27/2026	1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490761

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #18FD 4190223(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:53		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490762

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #18FL 4190201(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
<b>Inorganic Analytes - Metals</b>										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:55		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166

(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490763

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #19FD 4190213(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:56		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490764

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #19FL 4190250(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:58		1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490765

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #20FD 4190239(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:55		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166

(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490766

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808

Source: #20FL 4190179(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 08:01		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490767

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #21FD 4190232(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:52		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490768

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #21FL 4190188(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:54		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490769

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #22FD 4190219(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:54		2/1/2026

Analyst	Tests
DMJ	200.8

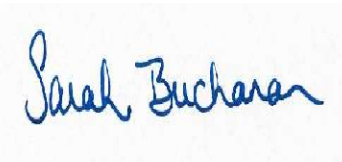

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490770

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #22FL 4190191(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:56		2/1/2026

Analyst	Tests
DMJ	200.8

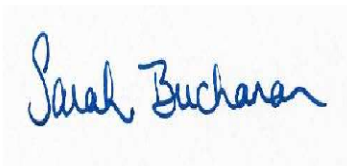

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490771

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #23FD 4190211(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:55		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490772

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #23FL 4190197(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:57		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490773

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #24FD 4190226(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:00		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490774

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #24FL 4190246(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:02		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490775

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #25FD 4190214(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:02		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490776

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #25FL 4190206(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:04		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490777

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808

Source: #26FD 4190209(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:05		2/1/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490778

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #26FL 4190185(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 07:07		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490779

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #27FD 4190236(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:12		2/1/2026

Analyst	Tests
DMJ	200.8

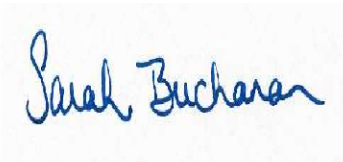

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

ANALYTICAL REPORTS

SAMPLE CODE: 490780  
 2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #27FL 4190193(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:14		2/1/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490781

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #28FD 4190233(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:08		1/25/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490782

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #28FL 4190203(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:10		1/25/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490783

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #29FD 4190216(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 05:59		1/25/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

ANALYTICAL REPORTS

SAMPLE CODE: 490784  
 2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #29FL 4190205(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:01		1/25/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490785

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #30FD 4190234(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:02		1/25/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490786

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #30FL 4190199(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:04		1/25/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## ANALYTICAL REPORTS

SAMPLE CODE: 490787

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808

Source: #31FD 4190225(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

## Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:04		1/25/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490788

2/13/2026

Customer: Walter Louis Fluid Technologies  
Jenn Tapuaiga  
530 South 5th Street  
ATTN: Jenn Tapuaiga  
Quincy, IL 62301-4808Source: #31FL 4190192(SO#-54332-WATMIL)  
Source City: Lawson  
Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	ND	1	1/14/2026 06:06		1/25/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166  
 (440) 449-2525, Fax: (440) 449-8585

ANALYTICAL REPORTS

SAMPLE CODE: 490789

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #32FD 4190231(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.

"DF" This column indicates the contaminant dilution factor.

Report Notes:

First Draw

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
<b>Inorganic Analytes - Metals</b>										
1030	Lead	200.8	0.010	mg/L	0.001	0.660*	1	1/14/2026 06:19	1/27/2026	1/31/2026

Analyst	Tests
DMJ	200.8

Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.

## National Testing Laboratories, Ltd

556 South Mansfield, Ypsilanti, MI, 48197-5166

(440) 449-2525, Fax: (440) 449-8585

## ANALYTICAL REPORTS

SAMPLE CODE: 490790

2/13/2026

Customer: Walter Louis Fluid Technologies  
 Jenn Tapuaiga  
 530 South 5th Street  
 ATTN: Jenn Tapuaiga  
 Quincy, IL 62301-4808

Source: #32FL 4190184(SO#-54332-WATMIL)  
 Source City: Lawson  
 Source State: MO

Date/Time Received: 1/21/2026 09:54

Collected by: N. Kiser

The results herein conform to TNI and ISO/IEC 17025:2017 standards, where applicable. These results may be used for compliance purposes, as required, unless otherwise narrated in the body of the report. The uncertainty of the test results are available upon request. All Dates and Times are reported as U.S. Eastern Time.

## Legend:

Any 'Level Detected' marked with an asterisk (\*) indicates that the value has exceeded the EPA Maximum Contaminant Level (MCL) or one of the Standards of Quality.

"ND" This contaminant was not detected at or above our lower reporting limit (LRL)

"NA" Not Analyzed

"Standard" This column indicates either the Maximum Contaminant Level (MCL) for EPA Primary Standards or the guideline values for EPA Secondary Standards.

"LRL" This column indicates the Lower Reporting Limit, which is the lowest level that the laboratory can detect a contaminant.


"DF" This column indicates the contaminant dilution factor.

Report Notes:

Flush

Fed Id #	Contaminant	Method	Standard	Units	LRL	Level Detected	DF	Date/Time Sampled	Date Prepped	Date/Time Analyzed
Inorganic Analytes - Metals										
1030	Lead	200.8	0.010	mg/L	0.001	0.180*	1	1/14/2026 06:21	1/27/2026	1/31/2026

Analyst	Tests
DMJ	200.8



Sarah Buchanan, Project Manager

This report cannot be reproduced, except in full, without the written approval of National Testing Laboratories, Ltd.